


Operator  
Telephone  
Fax  
e-Mail

## 2.10 / Summary

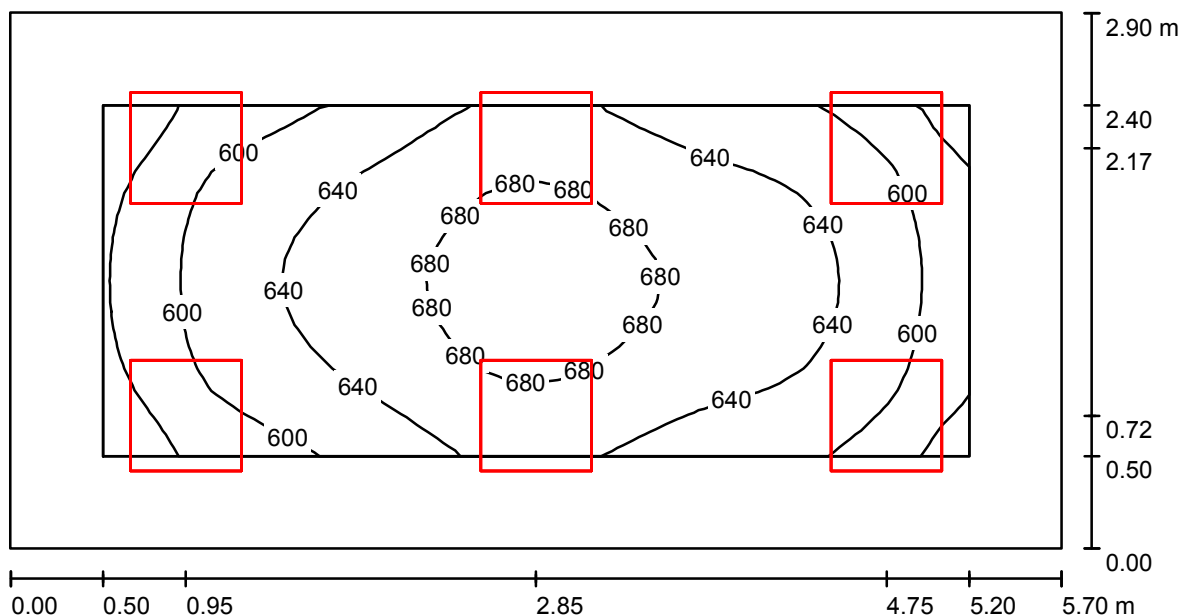

Height of Room: 3.100 m, Mounting Height: 3.100 m, Maintenance factor: 0.90

Values in Lux, Scale 1:41

Surface	$\rho$ [%]	$E_{av}$ [lx]	$E_{min}$ [lx]	$E_{max}$ [lx]	$u_0$
Workplane	/	633	524	698	0.828
Floor	20	458	315	549	0.687
Ceiling	70	163	129	225	0.792
Walls (4)	50	355	147	744	/

### Workplane:

Height: 0.800 m  
Grid: 32 x 16 Points  
Boundary Zone: 0.500 m

Illuminance Quotient (according to LG7): Walls / Working Plane: 0.619, Ceiling / Working Plane: 0.257.

Proportion of points with less than 400 lx (for IEQ-7): 0.00%.

### Luminaire Parts List

No.	Pieces	Designation (Correction Factor)	$\Phi$ (Luminaire) [lm]	$\Phi$ (Lamps) [lm]	P [W]
1	6	OCTA-LIGHT PLC OCTL-OLS-30-RNWR (1.000)	3040	3100	28.0
Total:			18239	18600	168.0

Specific connected load:  $10.16 \text{ W/m}^2 = 1.61 \text{ W/m}^2/100 \text{ lx}$  (Ground area:  $16.53 \text{ m}^2$ )