


Operator
Telephone
Fax
e-Mail

Медицински кабинет / Summary

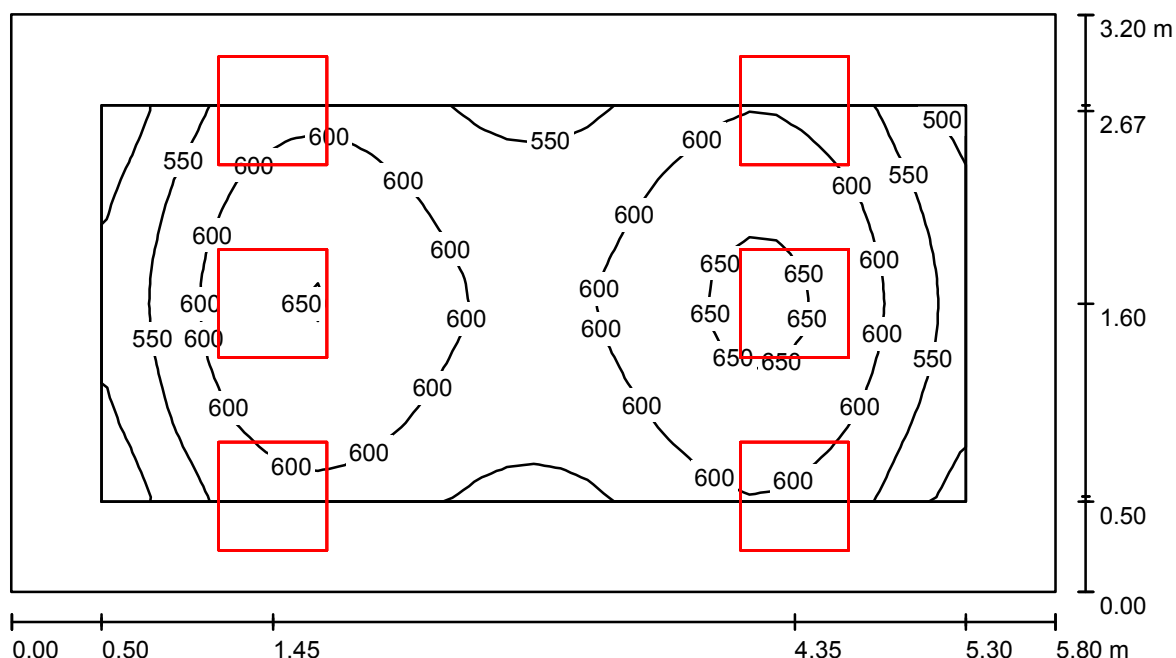

Height of Room: 3.150 m, Mounting Height: 3.150 m, Maintenance factor: 0.90

Values in Lux, Scale 1:42

| Surface | ρ [%] | E_{av} [lx] | E_{min} [lx] | E_{max} [lx] | u_0 |
|-----------|------------|---------------|----------------|----------------|-------|
| Workplane | / | 590 | 464 | 667 | 0.787 |
| Floor | 20 | 430 | 290 | 512 | 0.674 |
| Ceiling | 70 | 146 | 101 | 245 | 0.688 |
| Walls (4) | 50 | 322 | 122 | 1192 | / |

Workplane:

Height: 0.800 m
Grid: 32 x 16 Points
Boundary Zone: 0.500 m

Illuminance Quotient (according to LG7): Walls / Working Plane: 0.604, Ceiling / Working Plane: 0.248.

Proportion of points with less than 400 lx (for IEQ-7): 0.00%.

Luminaire Parts List

| No. | Pieces | Designation (Correction Factor) | Φ (Luminaire) [lm] | Φ (Lamps) [lm] | P [W] |
|--------|--------|---|-------------------------|---------------------|-------|
| 1 | 6 | OCTA-LIGHT PLC OCTL-OLS-30-RNWR (1.000) | 3040 | 3100 | 28.0 |
| Total: | | | 18239 | 18600 | 168.0 |

Specific connected load: $9.05 \text{ W/m}^2 = 1.53 \text{ W/m}^2/100 \text{ lx}$ (Ground area: 18.56 m^2)